

IRISeal PG2

**Intumescent sealant
for fireproofing of joints,
gaps and service
penetrations.**

IRISeal are waterborne fast-drying easy-to-use intumescent sealants.

PG2 is a grey water resistant sealant developing a higher pressure suitable for choking of plastic pipes and for outdoor application.

IRISeal are used for fireproofing of joints in stiff panels and walls, fireproof sealing of service penetrations, e.g. electrical or communication cables and pipes through separation walls, fireproof sealing of gaps in firewalls. To be used alone or in combination with fire grade high density rockwool or other fire resistant panels.

Intumescence means "swelling while charring". Special chemicals in the material react in excess of 200°C generating a low-density expanded char up to 100 times thicker than the original dry film. This char provides a very effective barrier to heat transfer protecting the substrate.

Resistance to fire includes the attitude of separating construction elements to maintain their characteristics of E = integrity and I = insulation during a fire, i.e. to avoid fire, smoke and dangerous gases to go through and to reduce heat transmission to the unexposed side to avoid propagation of fire.

In commercial and industrial facilities, hotels, airports, supermarkets, schools, hospitals, cinemas, theatres, the use of intumescent sealants reduces spread of fire preserving lives and property, allowing people evacuation and the safe operation of the fire brigade.

IRISeal PG2

DENSITY: 1,20 ± 0,05 kg/dm³ at 20°C

SOLIDS CONTENT:

65% ±5%w/w - 70% ±5%v/v

COLOUR: grey

STANDARD PACKING: 310ml plastic cartridge

SHELF LIFE: 12 months
in original packing and proper environment

APPLICATION: by cartridge nozzle or trowel

THINNING: No

DRYING TIME *

12 hours - touch
7 days - full depth

OVERCOATING: Yes after through drying

MIN APPLICATION TEMPERATURE +5°C

MAX APPLICATION TEMPERATURE +45°C

(*) @ +20°C and 60% RH. Drying time depends on DFT, temperature, relative humidity.


TEST, ASSESSMENT AND CLASSIFICATION REPORTS

APPLUS 15-11113-2634 P1

APPLUS 15/11113-2634-7

APPLUS 15/11113-2634-4

APPLUS 15/11113-2634-5

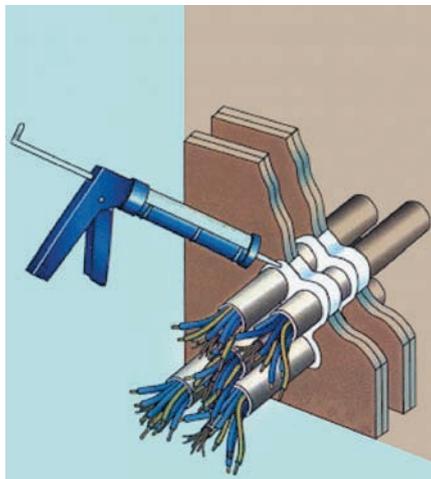

DISCLAIMER: Though based on the results of long term testing and experience the information given here is informative only. We cannot accept any liability for use of this information and the product unless a proper check has been done of the specific application, verified by the end-user. Accurate preliminary testing and definition of an application protocol and system is highly advisable to obtain full advantage of this product.

USE AND APPLICATION

IRISeal is applied by injection with its own cartridge and finished or smoothed by trowel, carefully filling any void space in the fire barrier. Application can be done both on new installations and for refurbishing. In case of maintenance, adding additional cables or pipes and any other such operation, the protection can be restored by simply re-coating and refilling the parts that have been added.

Cable trays penetrations: fix the cables regularly in the tray avoiding knots and overcrossings and put the cables close to each other to reduce the surface area exposed. The protection can be made by creating separate blocks of coated cables or coating the whole length. In both cases the whole surface of cables and the tray must be coated (upper side, lower side and sides). Gaps larger than 20 mm must be filled with subsequent applications after 3-4 hours from each other.

CERTIFICATIONS AND APPROVALS

IRISeal PG2 comes with European certification: Tested according to **EN 1363-1:2012** "Fire Resistance tests: General Requirements" and **EN 1366-3:2009** "Fire Resistance Tests for service installation. Part 3: Penetration seals" and **EN 1366-4:2006 +A1:2010** "Fire resistance tests for service installations. Part 4: Linear joint seals".

Classified for the determination of the fire resistance of penetration seals according to **EN 13501-2:2007+A1:2009** "Fire classification of construction products and building elements. Part 2: Classification using data from fire resistance tests, excluding ventilation services".

Our technical service will be happy to assist on the use of performance and classification data.

